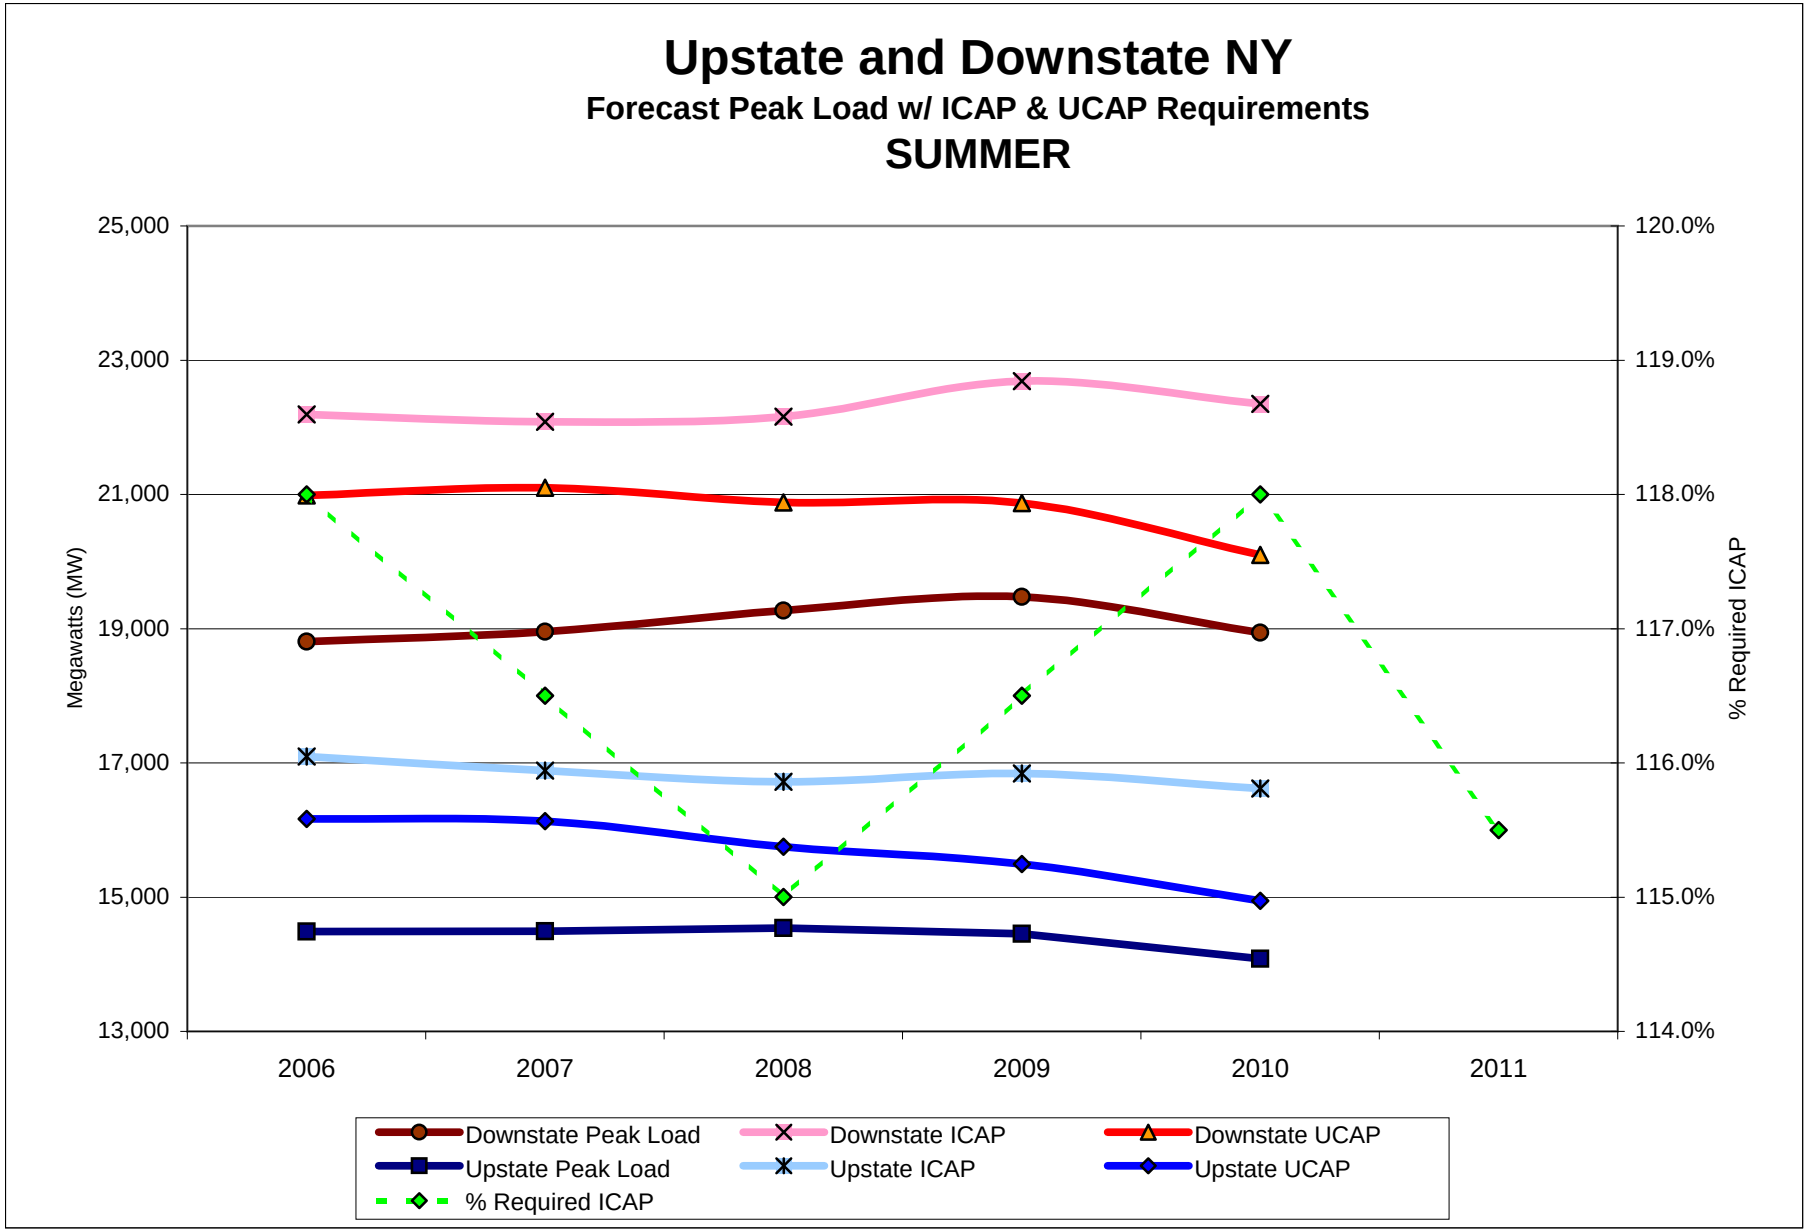
Upstate and Downstate NY
Forecast Peak Load w/ ICAP & UCAP Requirements
SUMMER
Megawatts (MW)
% Required ICAP
25,000
23,000
21,000
19,000
17,000
15,000
13,000
120.0%
119.0%
118.0%
117.0%
116.0%
115.0%
114.0%
2006
2007
2008
2009
2010
2011
Downstate Peak Load
Downstate ICAP
Downstate UCAP
Upstate Peak Load
Upstate ICAP
Upstate UCAP
% Required ICAP