



# Operations Performance Metrics Monthly Report

A Report by the  
New York Independent System Operator







**June 2025**

*Prepared by NYISO Operations Analysis and Services, based on settlements  
initial invoice data collected on or before July 9, 2025.*

## Table of Contents

<b>JUNE 2025 HIGHLIGHTS .....</b>	<b>3</b>
<b>NYCA GENERATION MIX .....</b>	<b>4</b>
<b>RELIABILITY PERFORMANCE METRICS .....</b>	<b>5</b>
Alert State Declarations	
Major Emergency State Declarations	
Reserve Activiations	
IROL Exceedance Times	
Disturbance Recovery Times	
Balancing Area Control Performance	
Thunderstorm Alert Hours	
Transmission Loading Relief Hours	
Load Forecasting Performance	
Net Load Ramp Trends	
Wind Forecasting Performance	
FTM Solar Forecasting Performance	
BTM Solar Forecasting Performance	
Net Wind & Solar Performance	
DAM Capacity Unavailable	
Lake Erie Circulation and ISO Schedules	
<b>MARKET PERFORMANCE METRICS.....</b>	<b>13</b>
RTM Congestion Residuals Monthly Trend	
RTM Congestion Residuals Daily Costs	
RTM Congestion Residuals Cost Categories	
RTM Congestion Residuals Event Summary	
DAM Congestion Residuals Monthly Trend	
DAM Congestion Residuals Daily Costs	
DAM Congestion Residuals Cost Categories	
NYCA Power Supplier Uplift Monthly Trend	
NYCA Power Supplier Uplift Daily Costs	
Local Reliability Costs Monthly Trend	
Local Reliability Monthly DARU & SRE Hours	
TCC Monthly Clearing Price with DAM Congestion	
ICAP Spot Market Clearing Price & Price Change Summary	
<b>APPENDIX .....</b>	<b>20</b>
Appendix A – Metric Definitions	
Appendix B – NYISO Information Resources	

## June 2025 Highlights


			
Monthly Metered Load		Historical Metered Load Peaks	
Peak Load	Minimum Load	Summer 2025 Peak Load	All-Time Summer Peak Load
31,857 MW 06/24/2025 HB 18	12,165 MW 06/01/2025 HB 07	31,857 MW 06/24/2025 HB 18	33,956 MW 07/19/2013 HB 16
Monthly Intermittent Resource Peaks		Historical Intermittent Resource Peaks	
			
Peak Wind	Peak Solar (FTM+BTM)	All-Time Peak Wind	All-Time Peak Solar (FTM+BTM)
2,159 MW 06/22/2025 HB 01	4,643 MW 06/24/2025 HB 12	2,309 MW 12/16/2024 HB 23	4,809 MW 04/17/2025 HB 12

## Notable NYCA System Events


- A Mid-June heat wave occurred on 6/23-6/25 affecting much of the Eastern Interconnection. Real-time loads approached the seasonal 90/10 forecasts. NYISO declared Emergency Energy Alert Level 1 on 6/24 due to tight capacity conditions and purchased emergency energy from neighboring control areas in real-time.
- NYISO called External ICAP suppliers on 6/23 HB16-18, 6/24 HB14-21 and 6/25 HB14-21.
- A Major Emergency was declared on 6/24 from 18:13-19:58 for shortages of total operating reserve.
- EDRP/SCR resources activated statewide on 6/23-6/25 HB14-21.
- Real-time prices during the heat wave reflected reserve and transmission shortages and scarcity conditions.
- Effective 6/01, the NYISO implemented updated regulation requirements and updated the [web posting](#) detailing the regulation requirements.

# NYCA Generation Mix

Generation Nameplate  
by Fuel Type

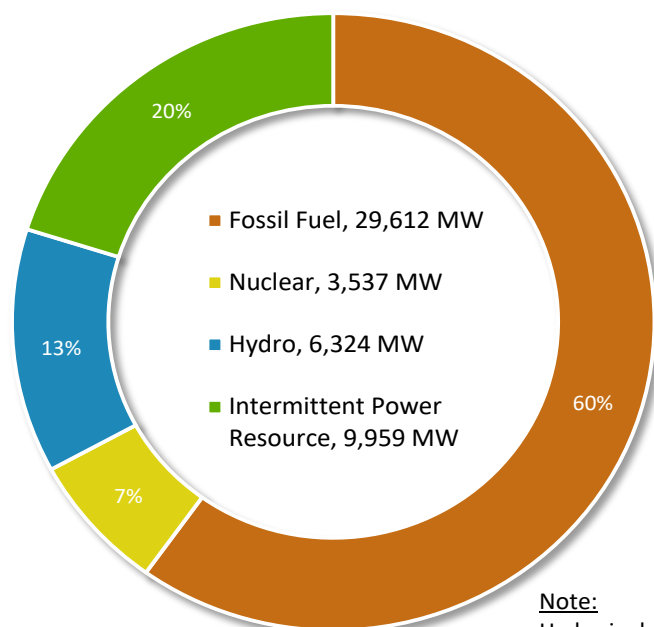


Intermittent Power  
Resource Nameplate

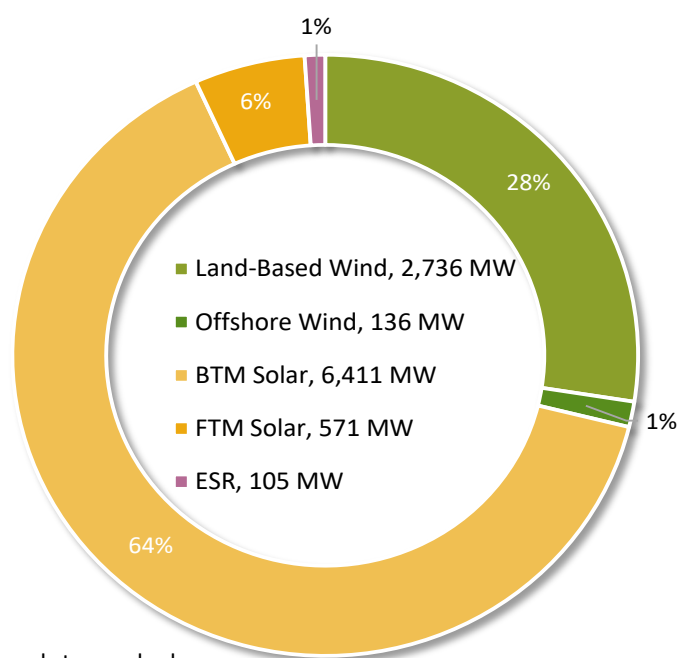

Note:  
Hydro includes pumped storage hydro  
ESR includes LESR


NYCA Load Served by Emissions-Free NYCA Generation

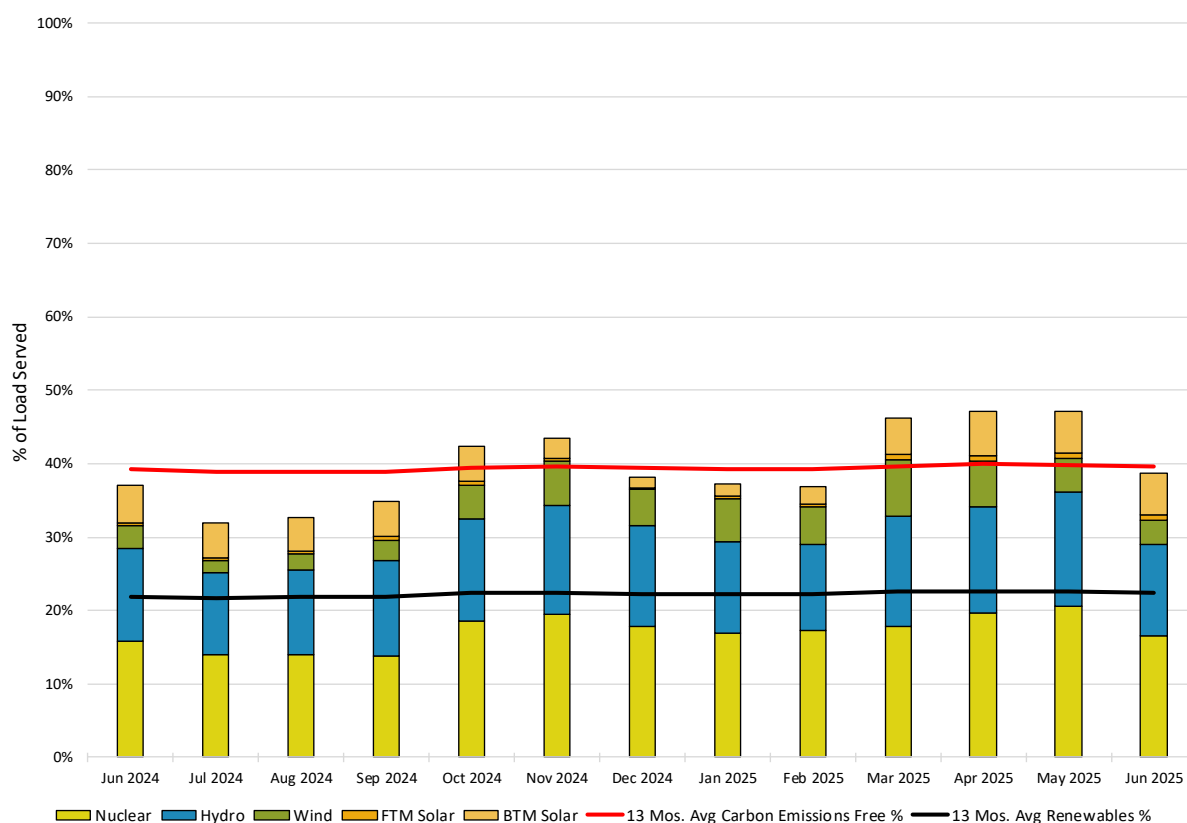


# Reliability Performance Metrics

See [Appendix A](#) for metric definitions


## Major Emergency State & Alert State Declarations

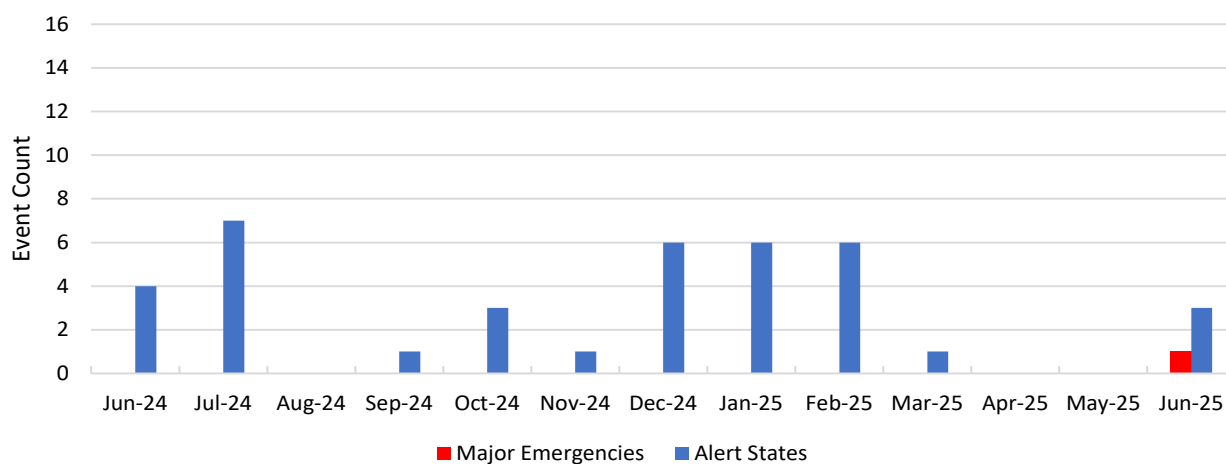


## Reserve Activations

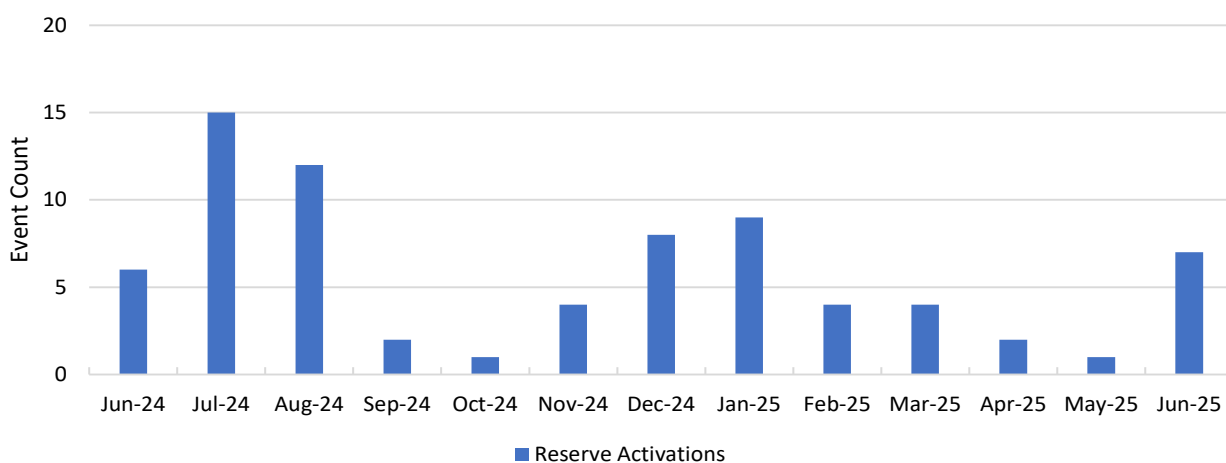


## NERC IROL and DCS Reportable Violation Minutes

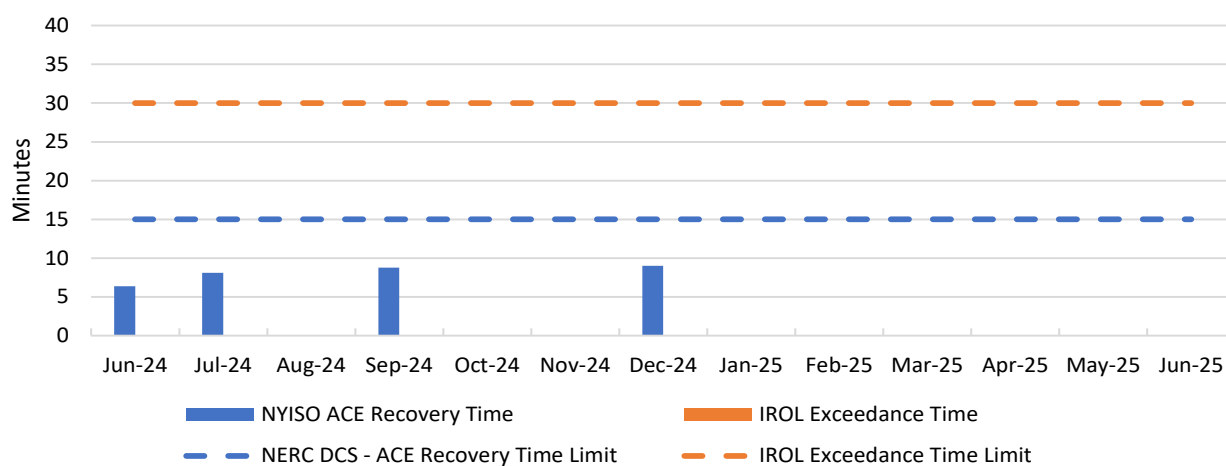


### NERC Control Performance Standard

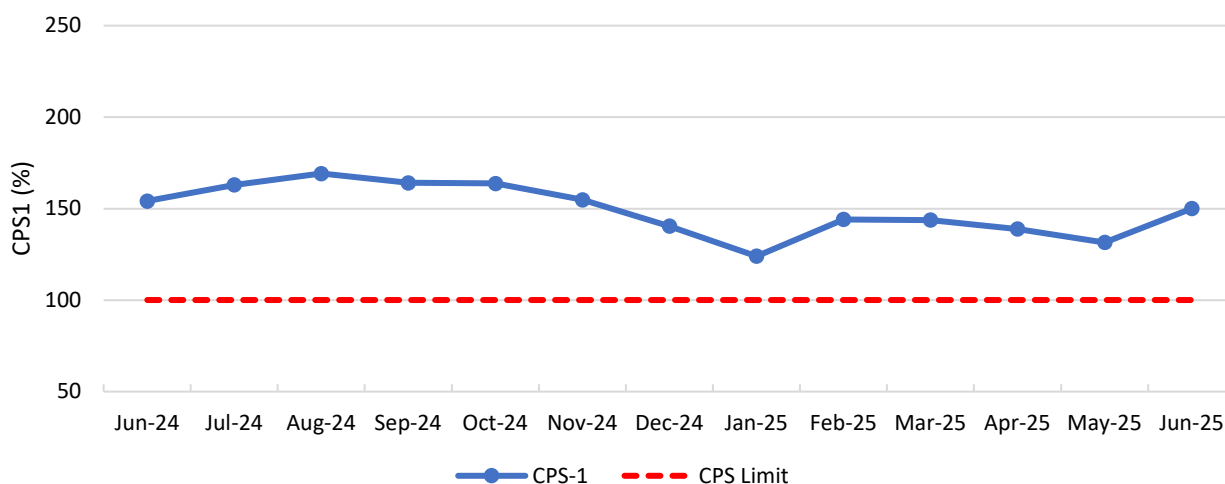


### NERC Balancing Authority ACE Limit Standard

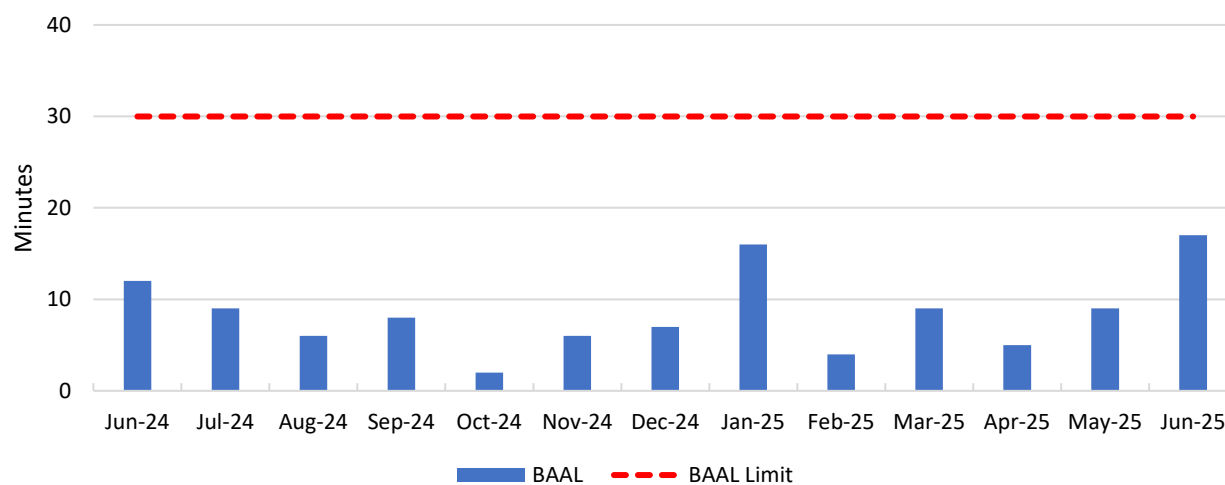


### Thunderstorm Alert Hours and NERC TLR-3 Hours



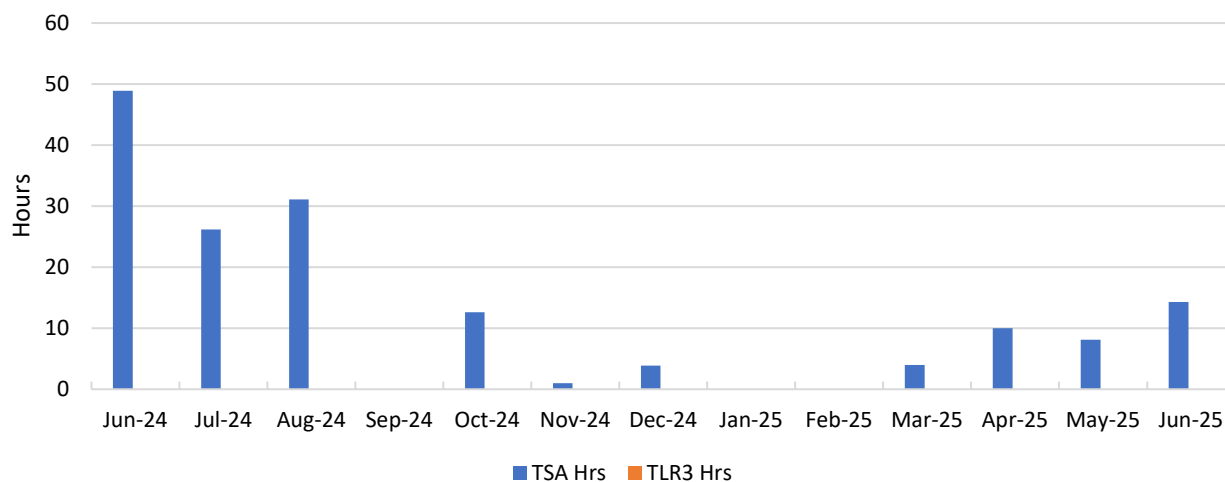


## Load Forecast Performance

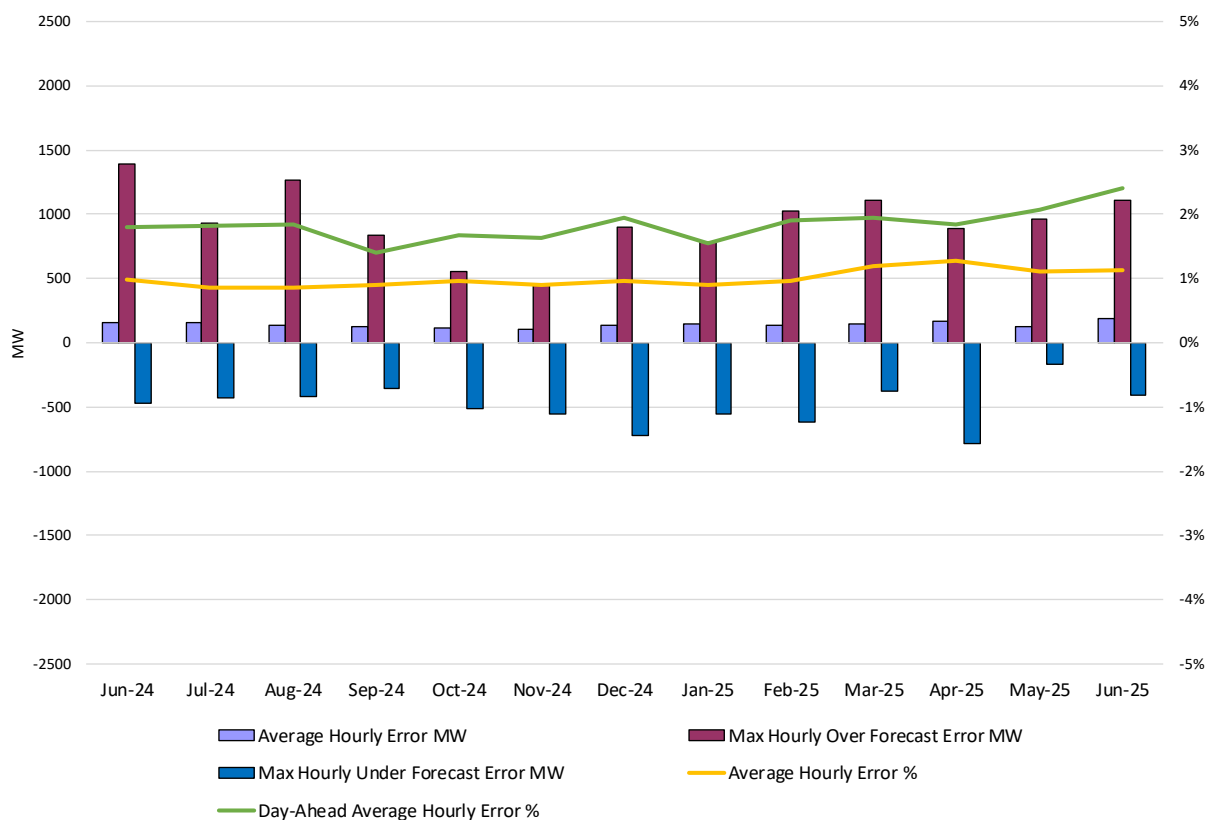


## Average Hourly Net Load Ramps June 2025

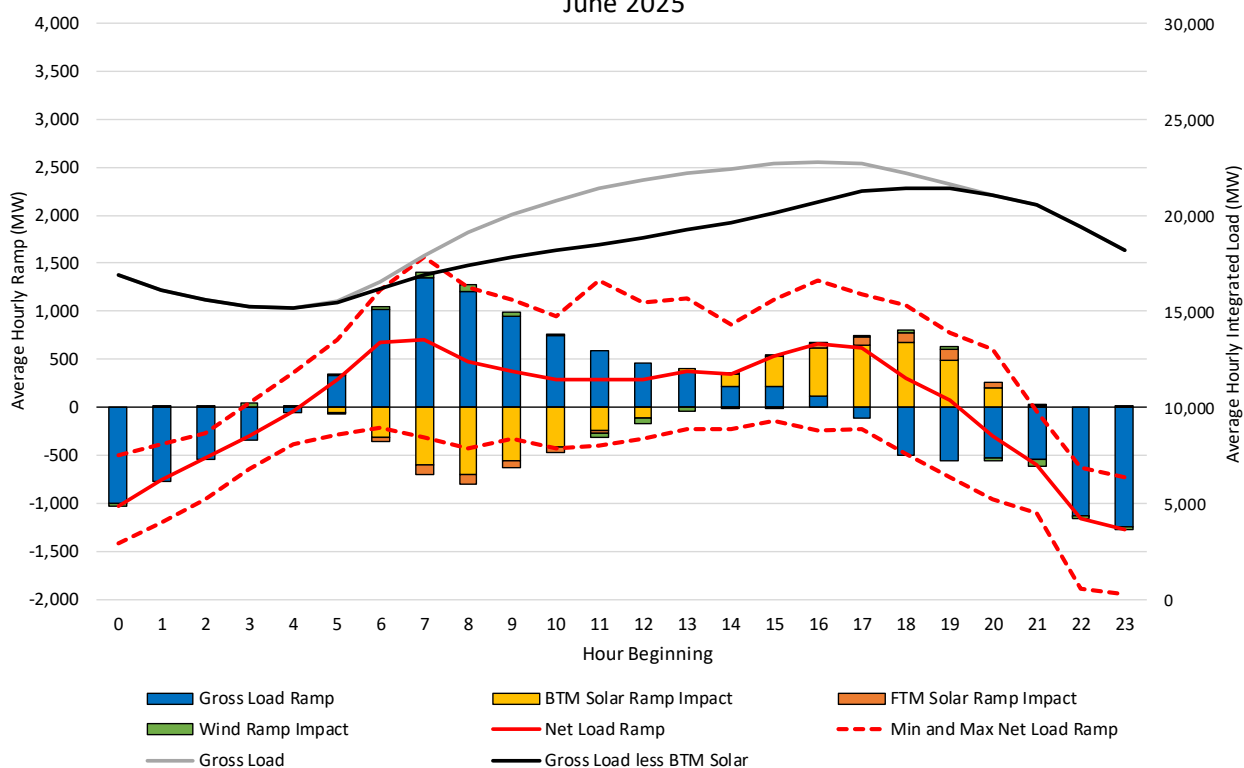

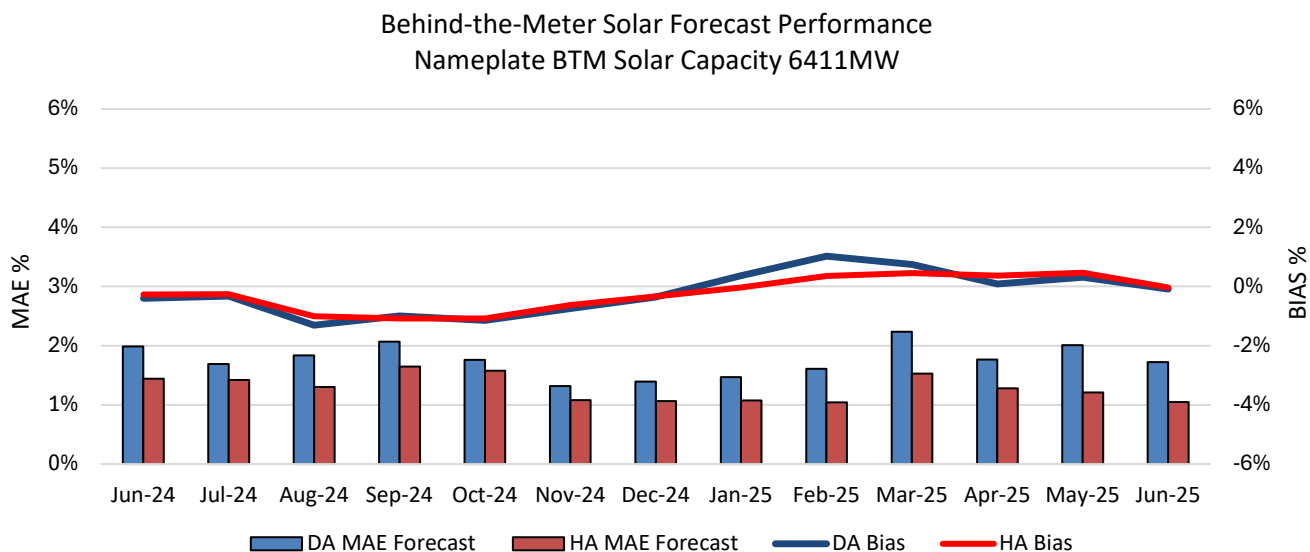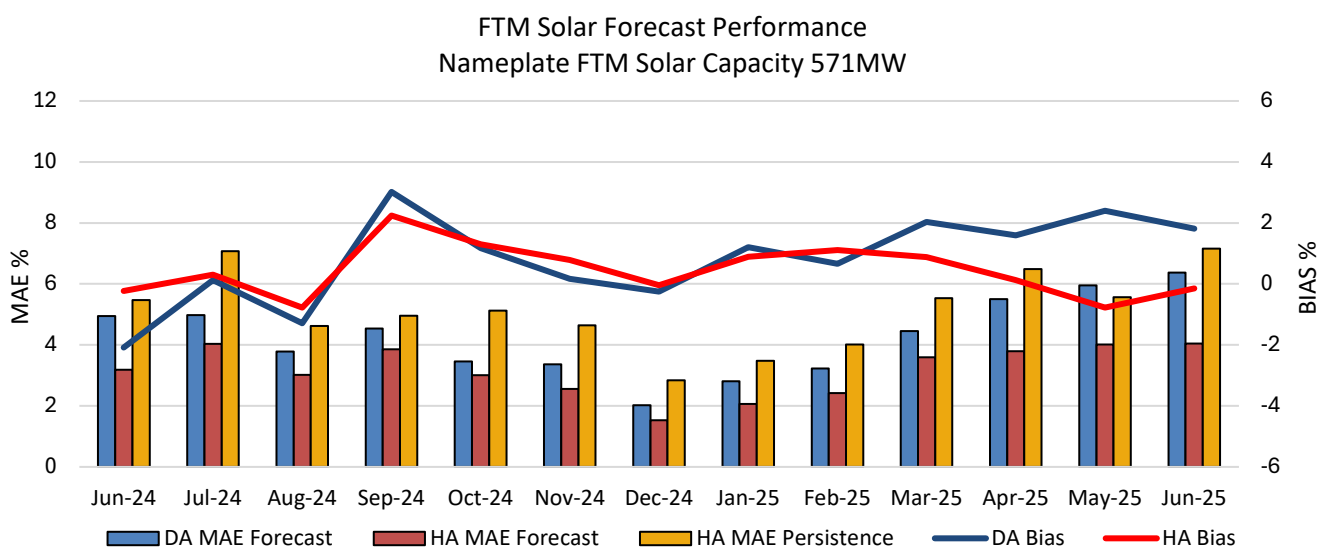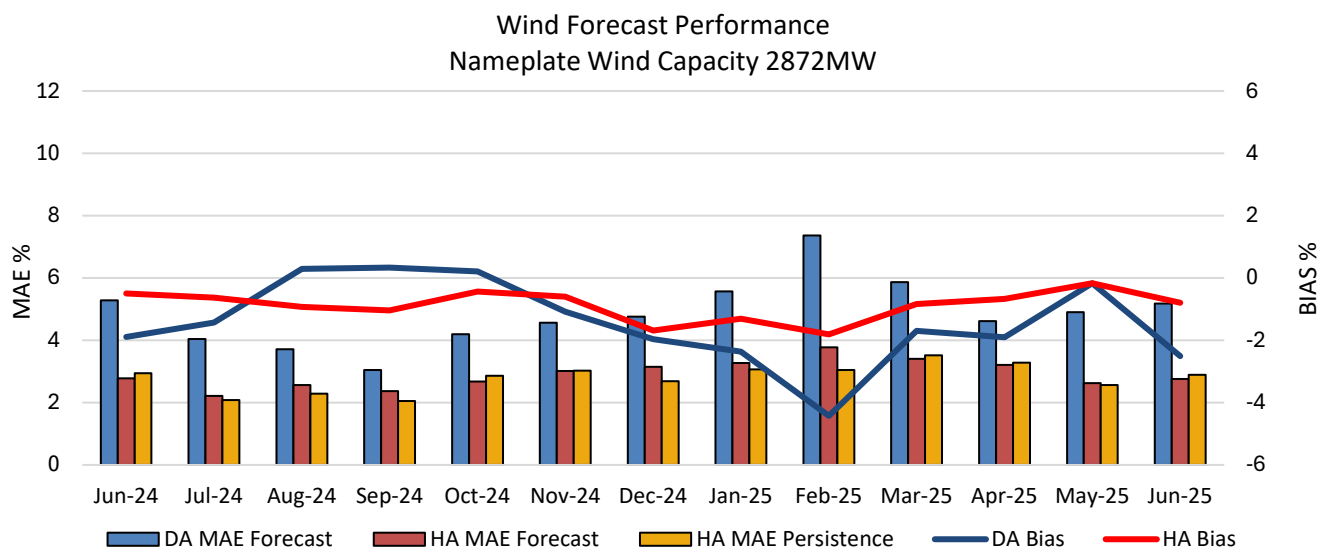





### Net Wind and Solar Performance Total Monthly Production and Capacity Factors

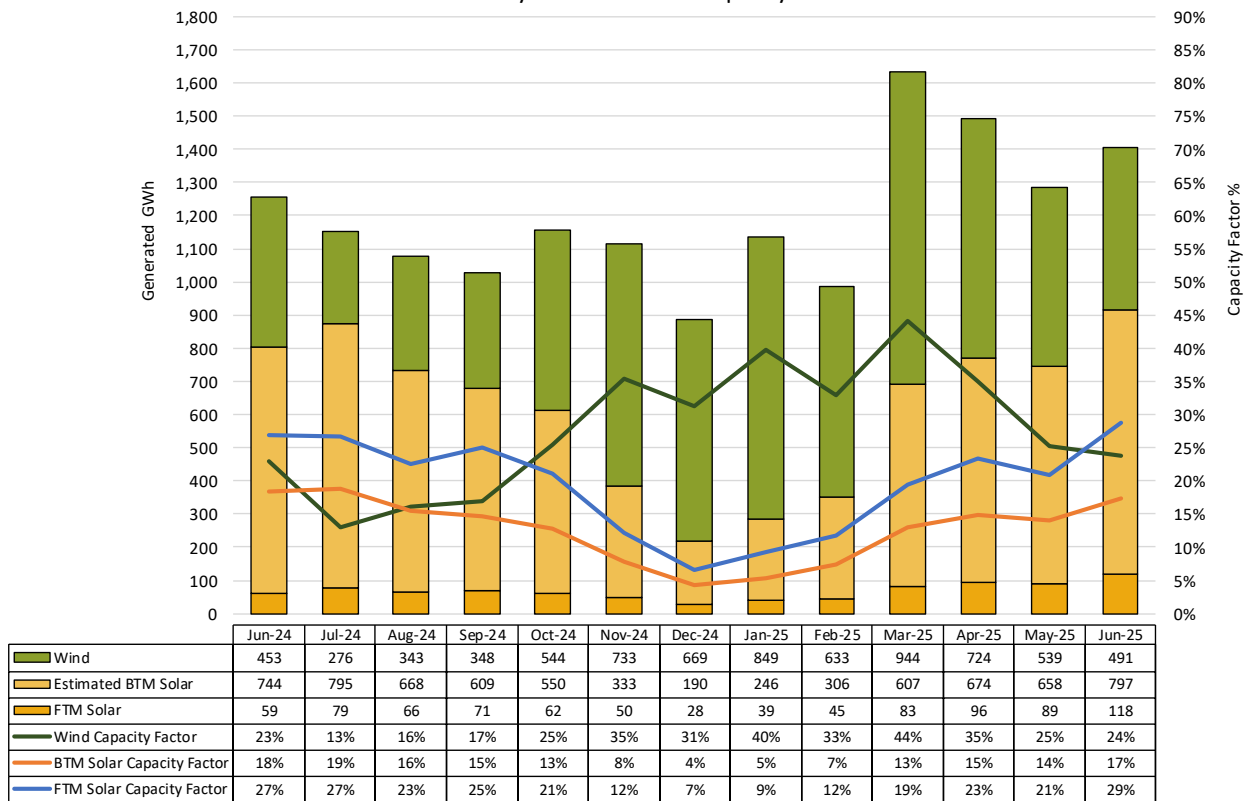


### Net Wind and Solar Performance Total Daily Production and Capacity Factors


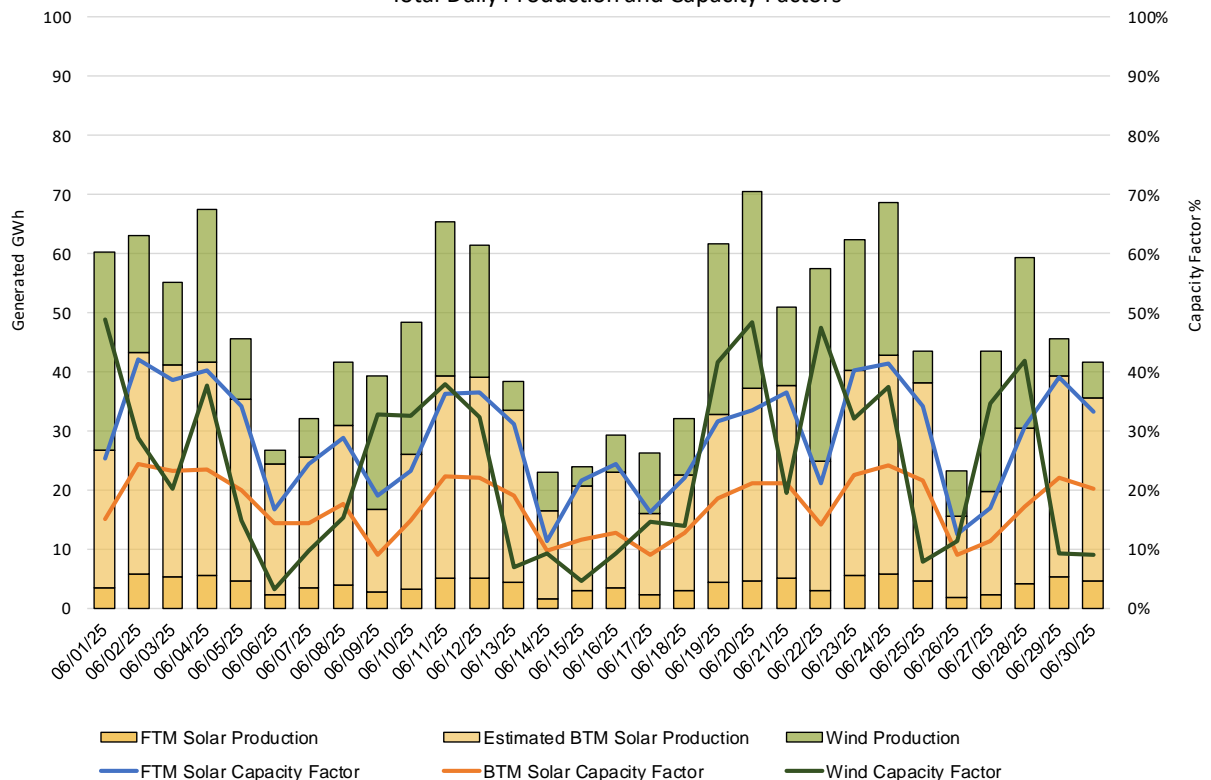


### Net Wind and FTM Solar Performance Monthly Energy Curtailment

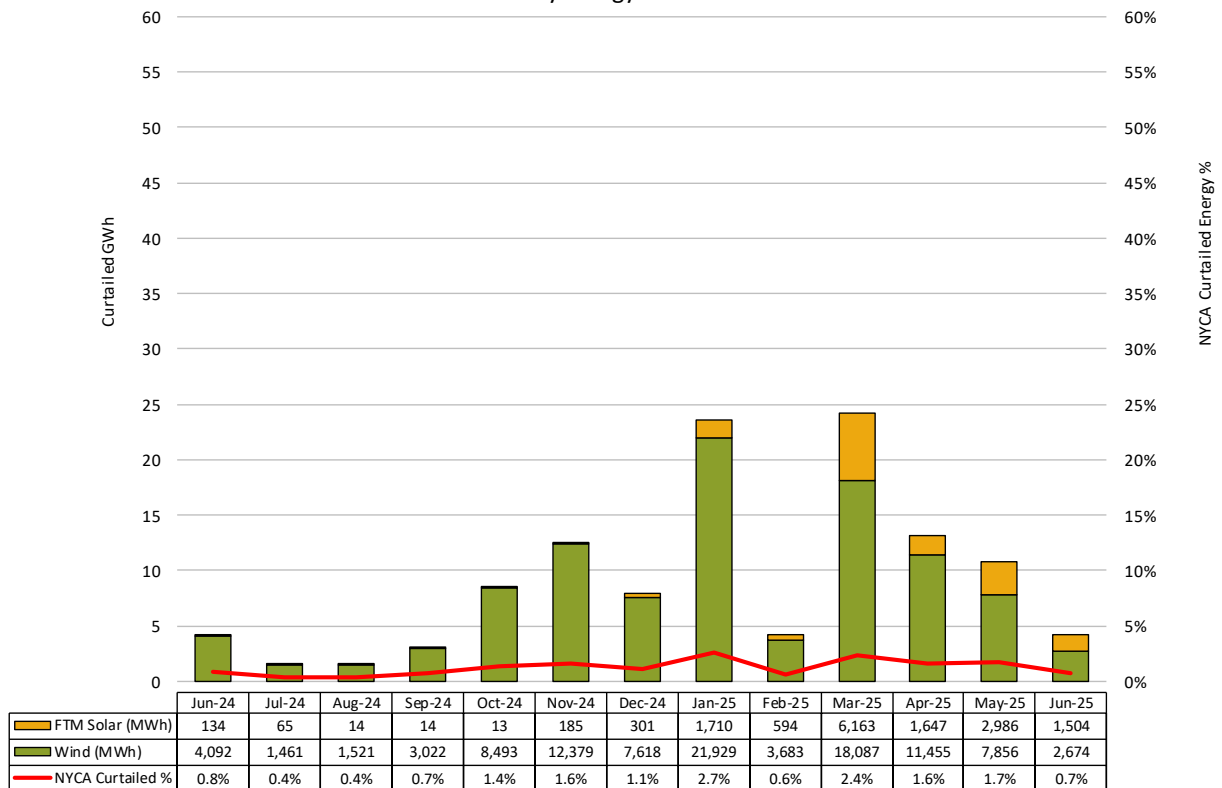


### Net Wind and FTM Solar Performance Monthly Energy Curtailment by Limiting Constraint

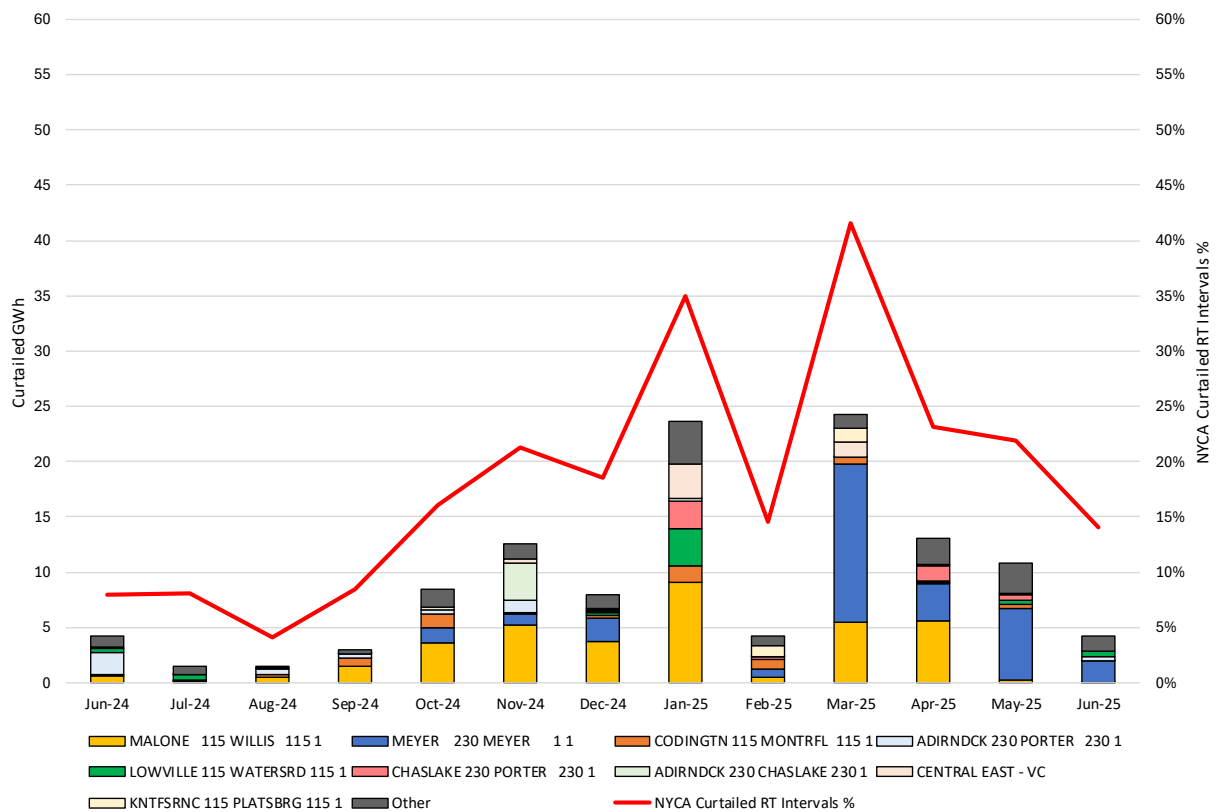

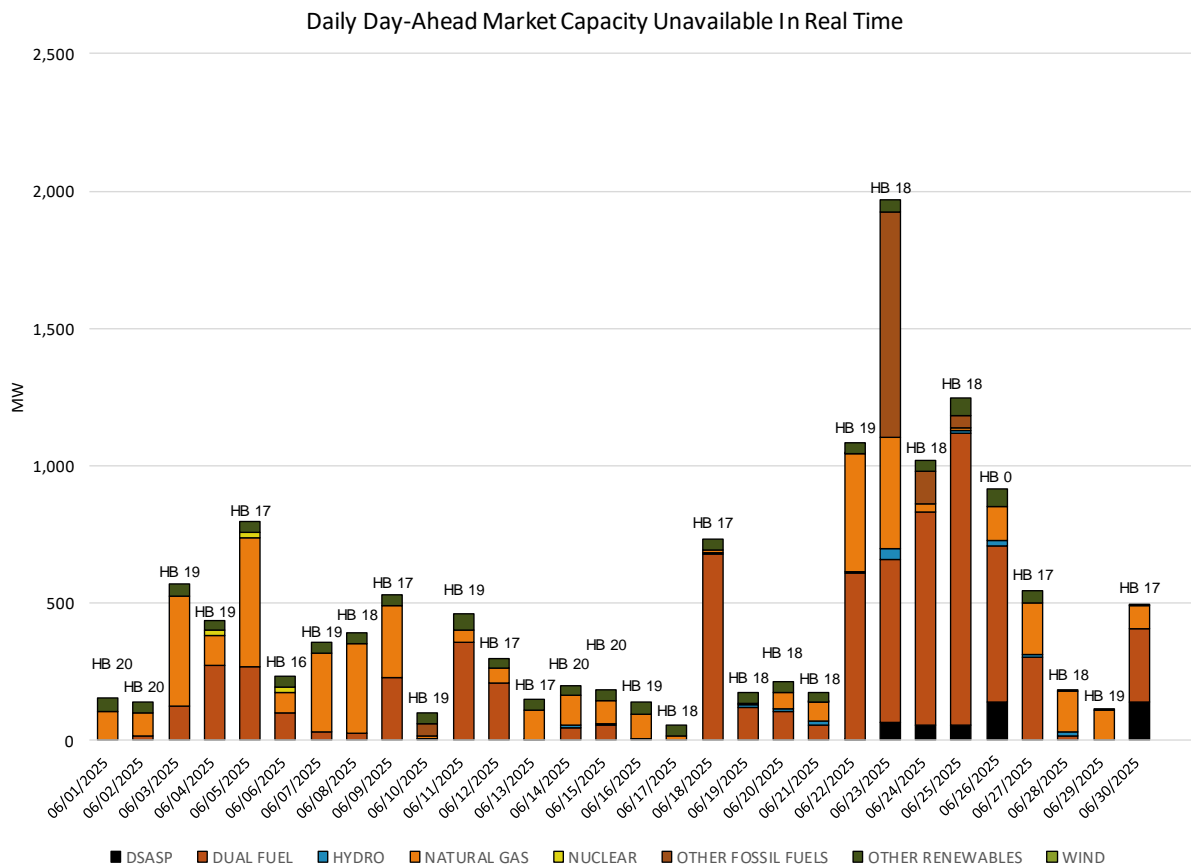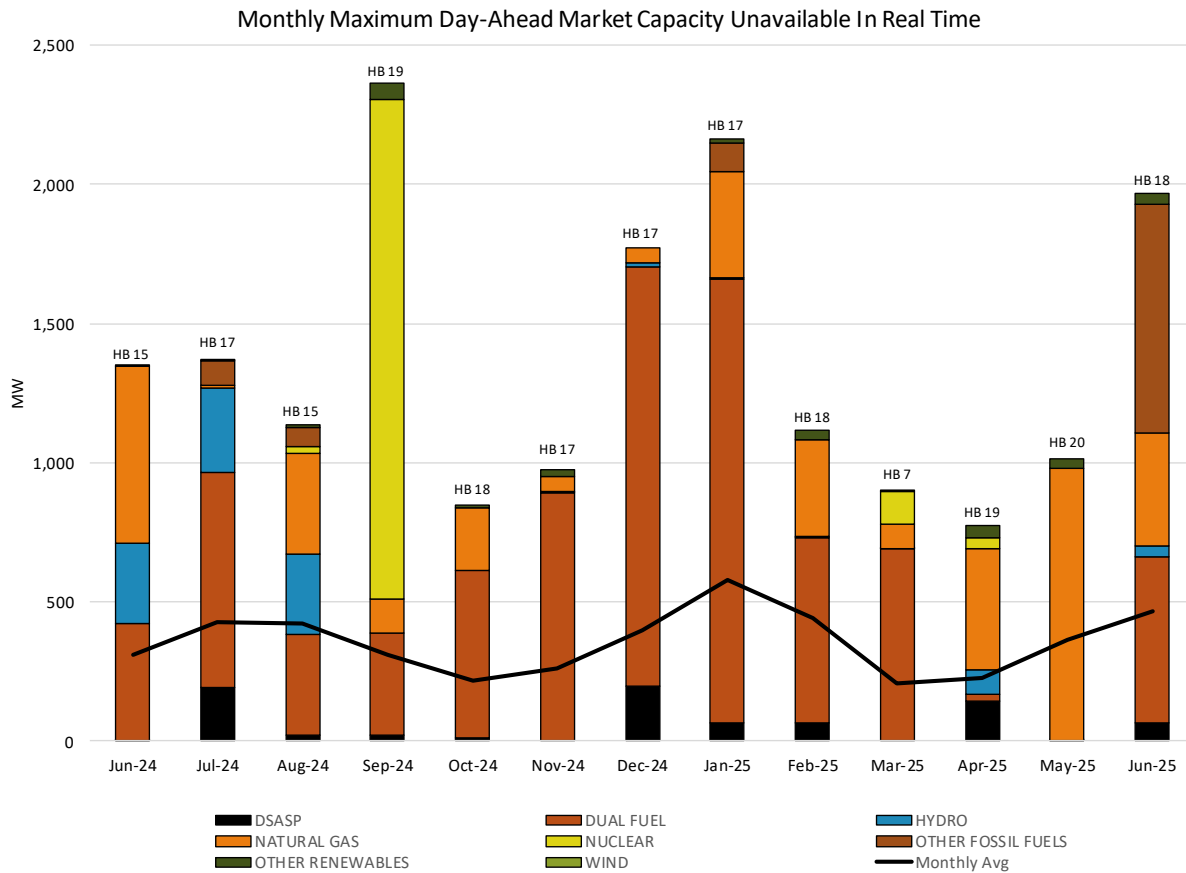


Lake Erie Circulation and ISO Net Interchange Schedules  
Monthly Averages

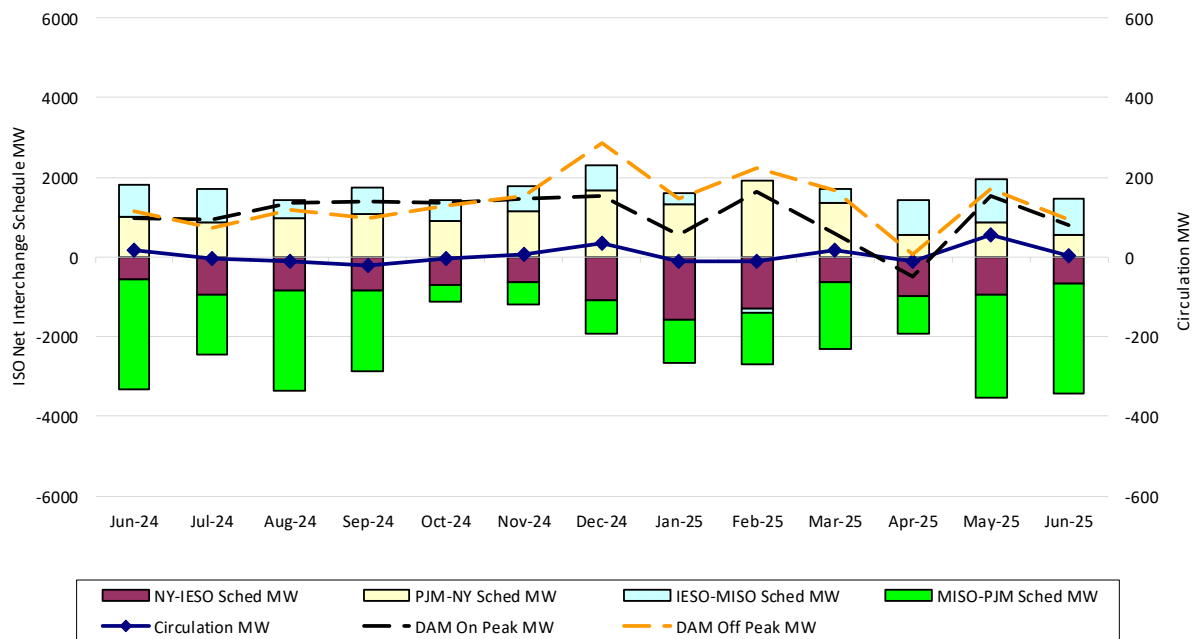

Interchange schedules with positive values aggravate clockwise Lake Erie Circulation.


Lake Erie Circulation and ISO Net Interchange Schedules  
Daily Averages

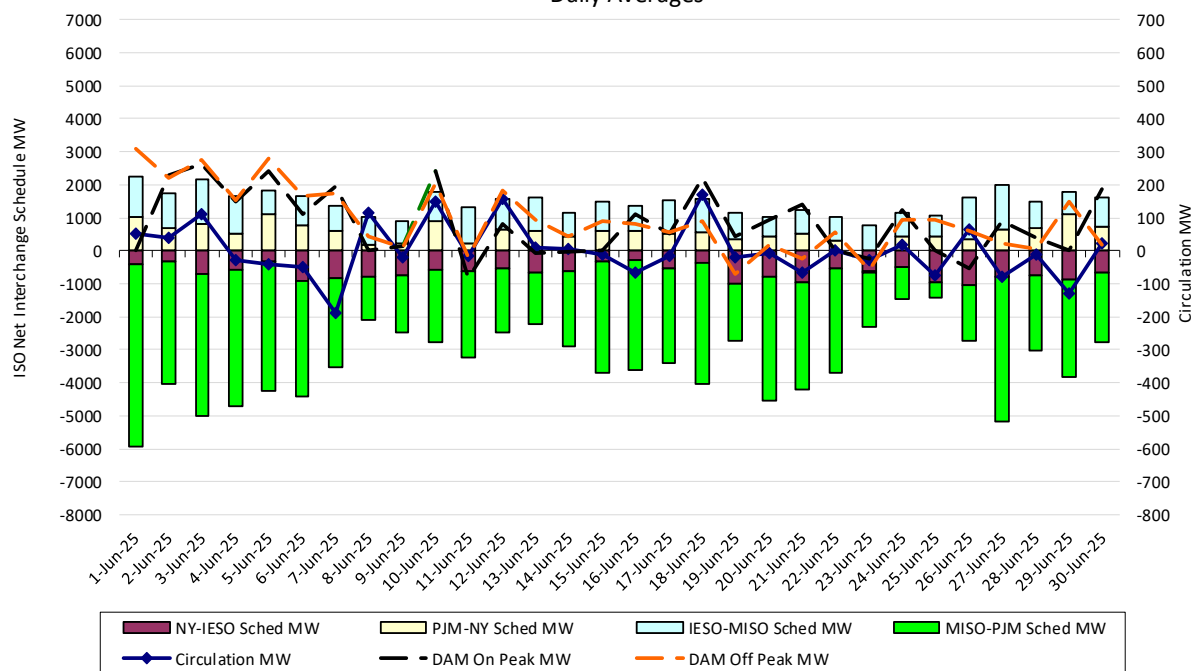


Interchange schedules with positive values aggravate clockwise Lake Erie Circulation.

# Market Performance Metrics

## Balancing Market Congestion Residual Monthly Uplift Cost Categories

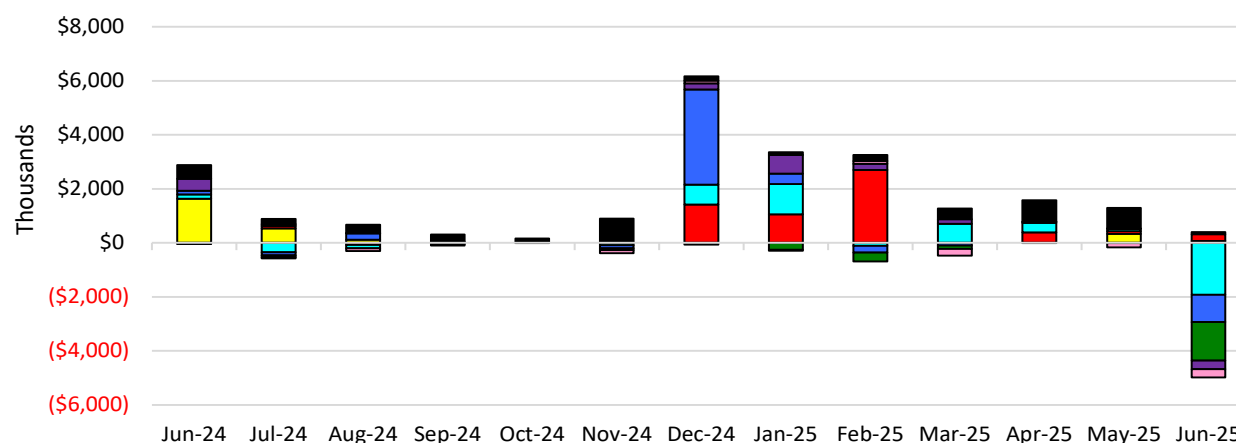

## Daily Uplift Cost Categories

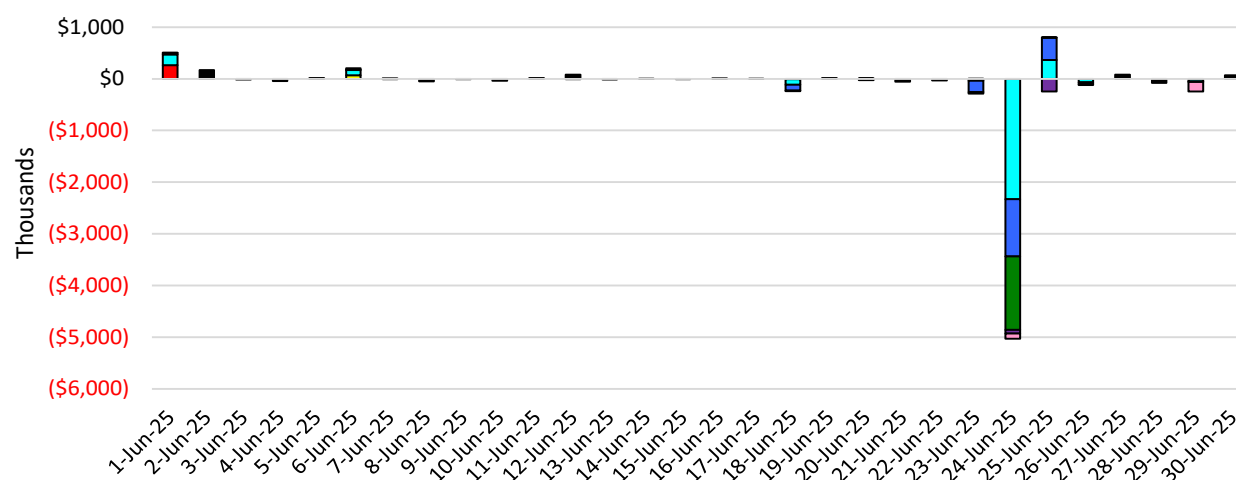

## Real-Time Balancing Market Congestion Residual Categories


Category	Cost Assignment	Events Types	Event Examples
Storm Watch	Zone J	Thunderstorm Alert (TSA)	TSA Activations
Transmission Outage Mismatch	Market-wide	Changes in DAM to RTM transfers related to transmission outage mismatch	Forced Line Outages, Unit AVR Outages, Early Line Return from Outage
Interface/Facility Rerate - NYISO Security	Market-wide	Changes in DAM to RTM transfers not related to transmission outage	Interface/Facility Rerates due to RTM voltages
Interface Rerate - External Security	Market-wide	Changes in DAM to RTM transfers related to External Control Area Security Events	TLR Events, External Transaction Curtailments
Unscheduled Loop Flows	Market-wide	Changes in DAM to RTM unscheduled loop flows impacting NYISO Interface transmission constraints	DAM to RTM Lake Erie Loop Flow exceeding +/-125MW
M2M Settlement	Market-wide	Settlement result inclusive of coordinated redispatch and Ramapo flowgates	
Cost Not Categorized	Market-wide		
Not Investigated	Market-wide		

**Monthly Balancing Market Congestion Report Assumptions/Notes**


- 1) Storm Watch Costs are identified as daily total uplift costs
- 2) Days with a value of BMCR less M2M Settlement of \$100K/HR, shortfall of \$200K/Day or more, or surplus of \$100K/Day or more are investigated.
- 3) Uplift costs associated with multiple event types are apportioned equally by hour

Day's investigated in June:1,6,18,23,24,25,26,29		
Event	Description	June Dates
	Thunder Storm Alert, Van Wagner-Leeds (#92)	6
	Early Return to Service Lake Success-Shore Road 138kV (#368)	18
	Forced Outage Goethals-LindenCoGen 345kV (#G23M)	1
	Forced Outage Stewart Ave-Valley Stream 138kV (#261)	1
	Derate Adirondack-Porter 230kV (#12) I/o SIN:MSU1&7040& HQ GN&LD PROXY	23
	Derate Barrett-Freeport 138kV (#459)	1,6
	Derate BrownFalls-Taylorville 115kV (#3) I/o BrownFalls-Taylorville 115kV (#4)	23
	Derate Freeport-Newbridge 138kV (#461)	1,6
	Derate Gowanus-Greenwood 138kV (#42231)	23
	Derate Gowanus-Greenwood 138kV (#42232)	23
	Derate Lake Success-Shore Road 138kV (#367)	1,6
	Derate Lowville-Waters Road 115kV (#7) I/o SIN:WATRD-BNVL_TAP-BOONVL_8	23,24
	Derate Stewart Ave-Valley Stream 138kV (#262) I/o BUS:BARRETT 292&459&G2	6
	Derate Stewart Ave-Valley Stream 138kV (#262) I/o SCB:NEWBRDG(1380)461&BK6+4&R1	6
	Derate Van Wagner-Athens 345kV (#91) I/o Leeds-Van Wagner 345kV (#92)	25
	Derate Van Wagner-Leeds 345kV (#92) I/o Athens-Van Wagner 345kV (#91)	25
	NYCA DNI Ramp Limit	6,18,23-26
	Uprate Astoria West-Hellgate 138kV (#24051) I/o SIN:HELLG-ASTOR_24052&15055M&B	23,24
	Uprate Freshkills-Willow Brook 138kV (#29212)	25
	Uprate Goethals-Gowanus 345kV (#25)	24-26
	Uprate Scriba-Volney 345kV (#20) I/o Scriba-Volney 345kV (#21)	29
	HQ_CEDARS - NY Scheduling Limit	23-25
	HQ_CHAT - NY Scheduling Limit	23,24
	HQ_CHAT Active DNI Ramp Limit	6
	IESO_AC - NY Scheduling Limit	25
	IESO_AC Active DNI Ramp Limit	18,23,24
	NE_AC - NY Scheduling Limit	6,18,23,29
	NE_AC Active DNI Ramp Limit	1,23,25
	PJM_AC - NY Scheduling Limit	23,26,29
	PJM_AC Active DNI Ramp Limit	1,23-26
	Lake Erie Circulation, DAM-RTM exceeds +/-125MW; West	23,24

## DAM Congestion Residual Monthly Cost Categories

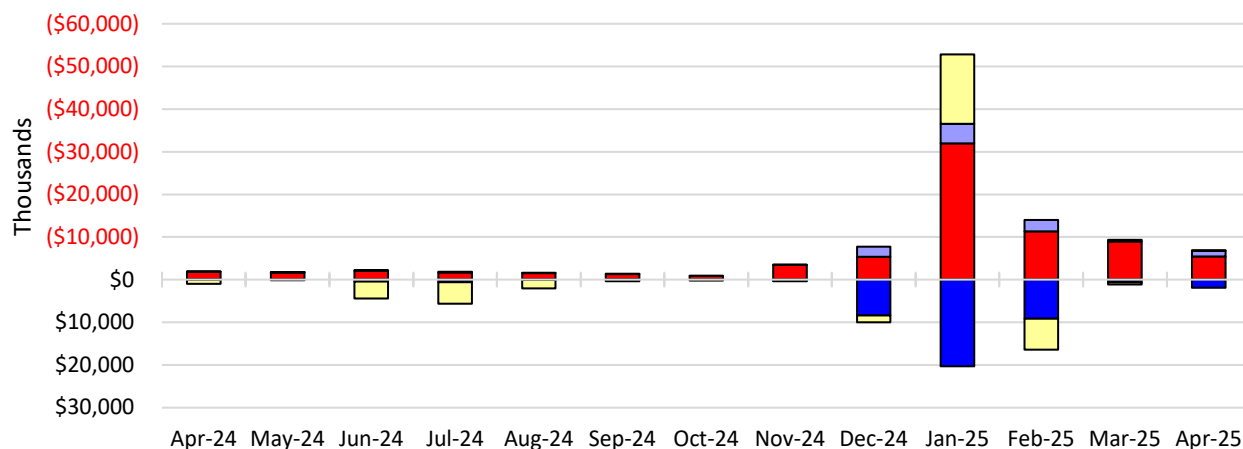


## Daily Cost Categories

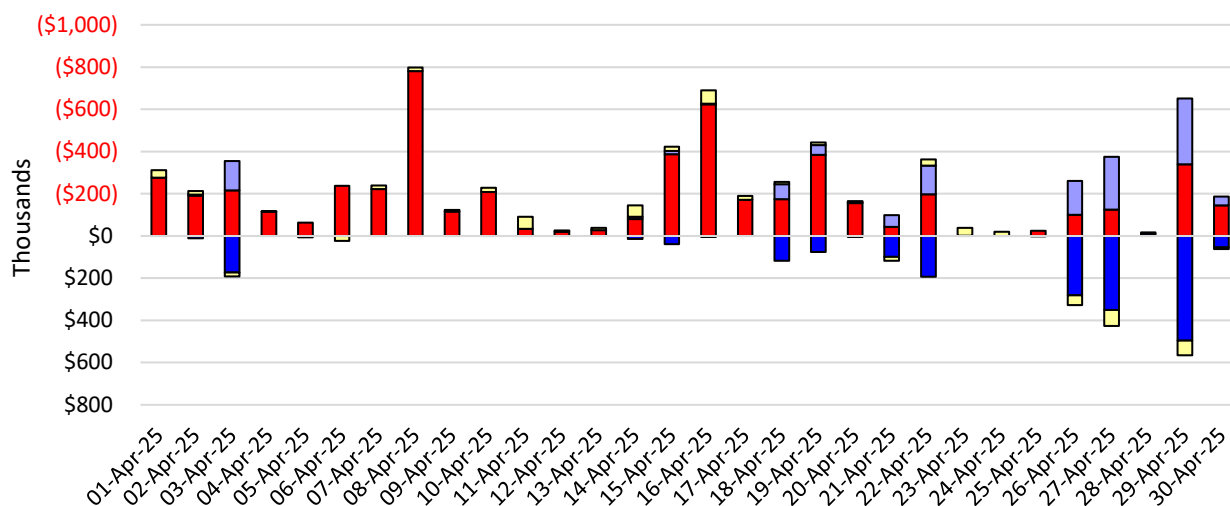


### DAM Congestion Residual Categories

Category	Cost Assignment	Events Types	Event Examples
NYTO Outage Allocation	Responsible TO	Direct allocation to NYTO's responsible for transmission equipment status change.	DAM scheduled outage for equipment modeled in-service for the TCC Auction.
Incremental TCC/External Outage Impacts	All TO by Monthly Allocation Factor	Allocation associated with transmission equipment status change caused by change in status of external equipment or change in status of equipment associated with Incremental TCC.	Tie line required out-of-service by TO of neighboring control area.
Central East Commitment Rerate	All TO by Monthly Allocation Factor	Changes in the DAM Central East VC limit as compared to the TCC Auction limit, which are not associated with transmission line outages.	
Cost Not Categorized	All TO by Monthly Allocation Factor		

### Monthly Power Supplier Uplift Components

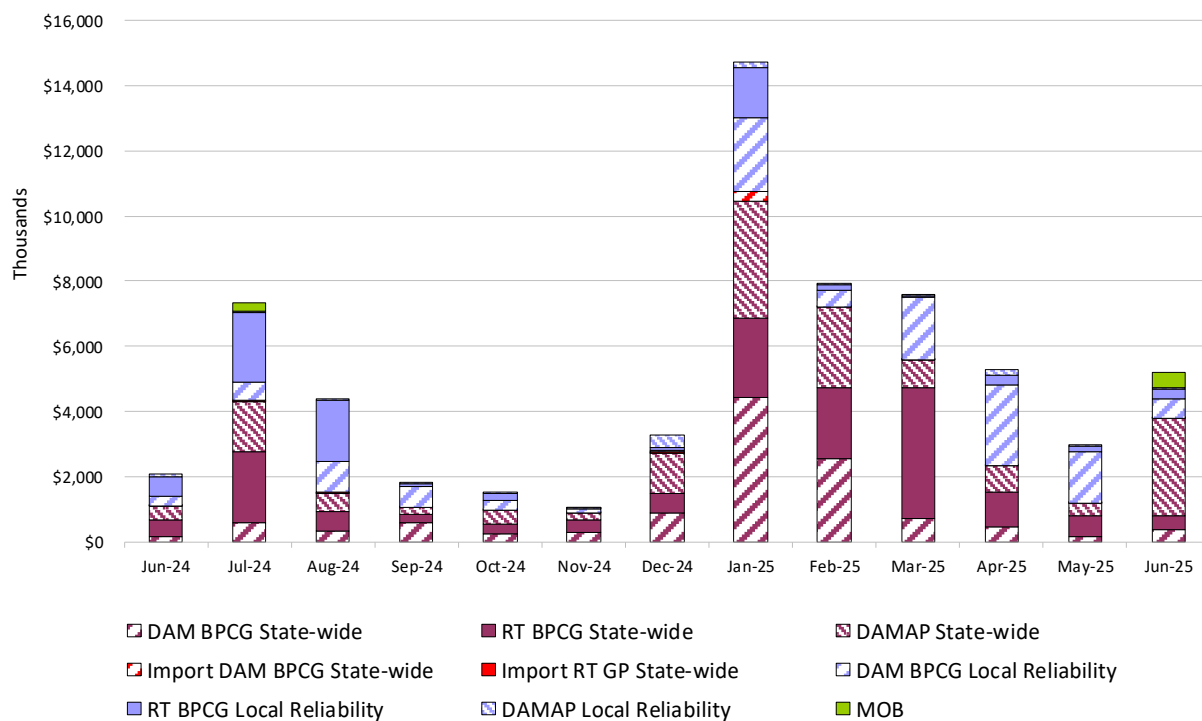


### June 2025 Daily NYCA Unit Uplift Components

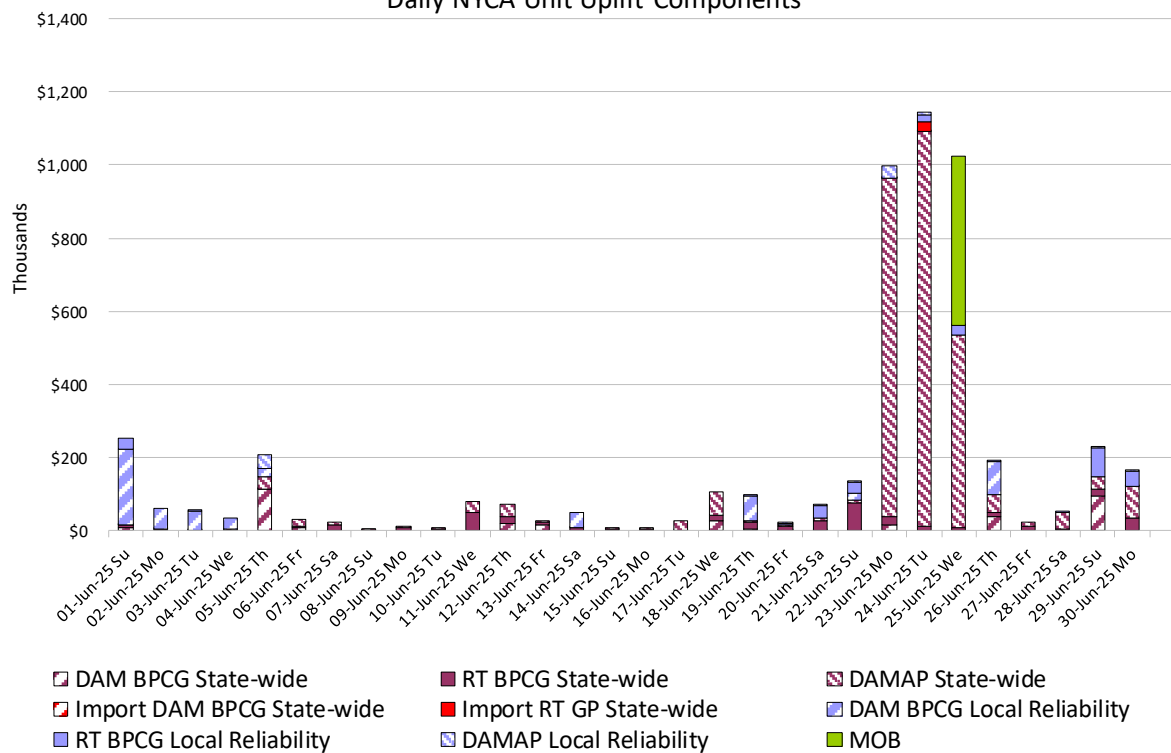





### Local Reliability Cost - NYC & LONGIL Monthly RT BPCG, DAM BPCG, DAMAP & Minimum Oil Burn Costs

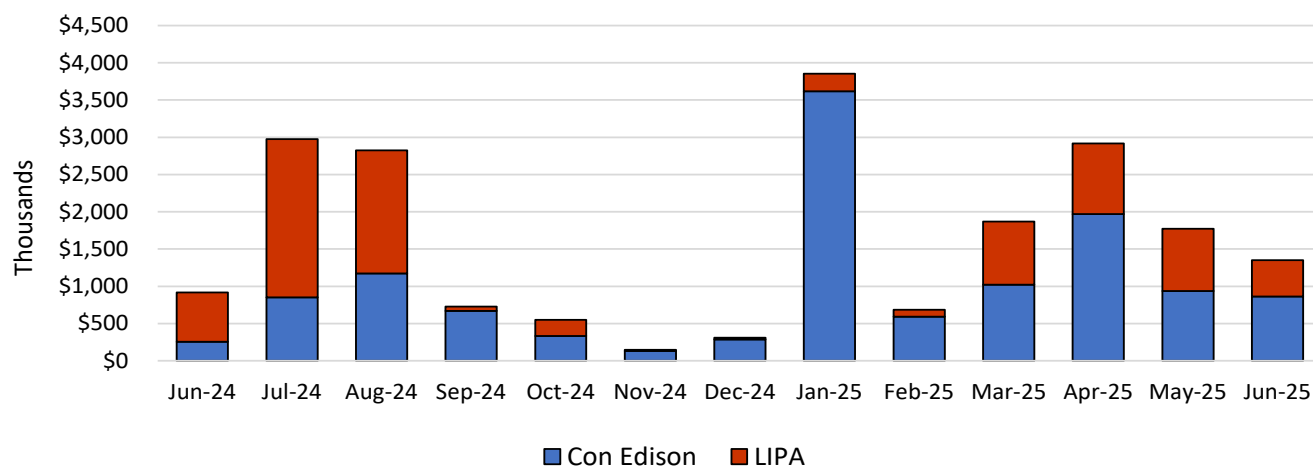




### Local Reliability Cost - Rest of State Monthly RT BPCG, DAM BPCG & DAMAP Costs

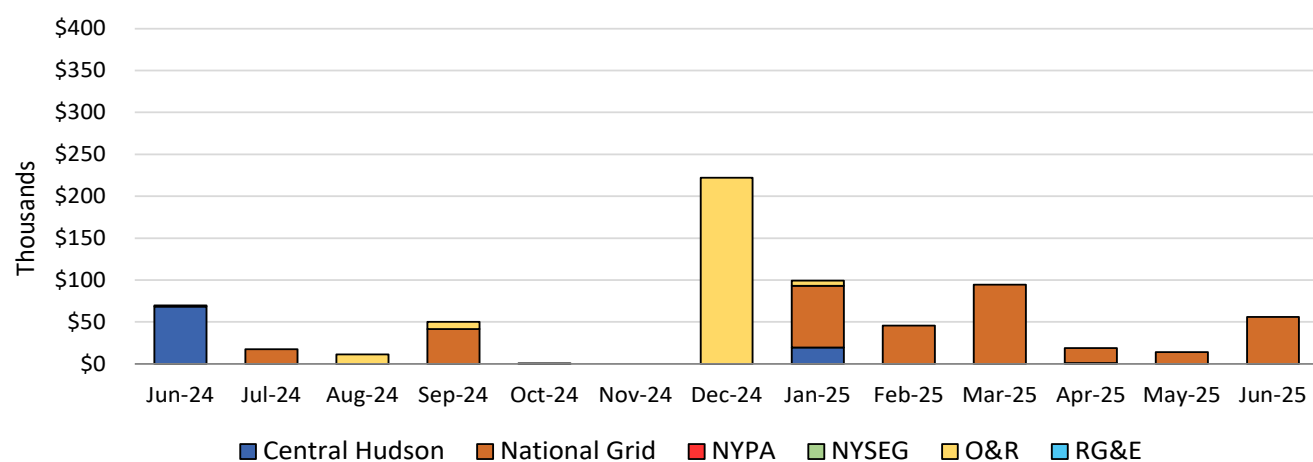


### Local Reliability Commitments June 2025 DARU & SRE Hours

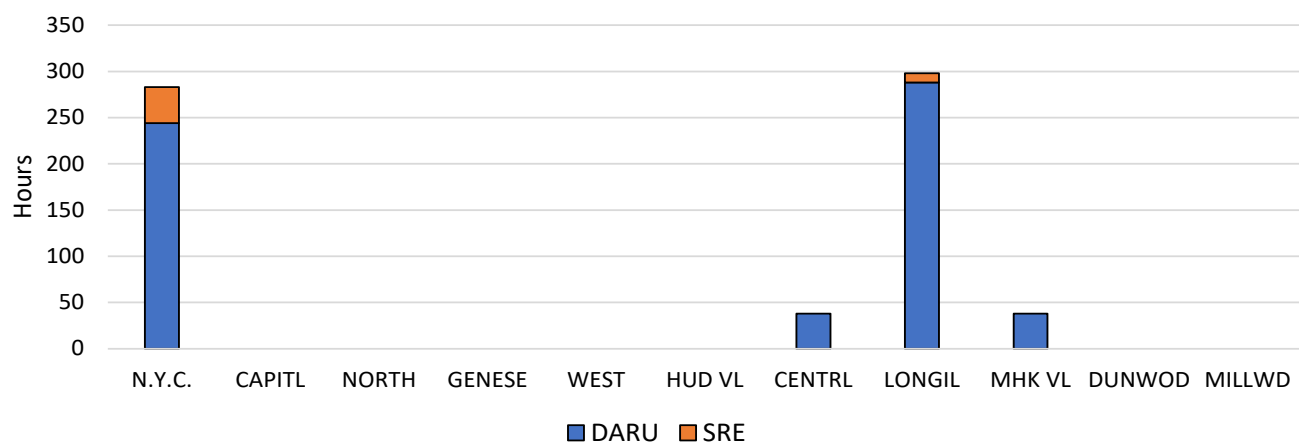

TCC Monthly Reconfiguration Auction vs. Monthly DAM Average  
with Spring 2025 Centralized TCC Auction Six-Month Average

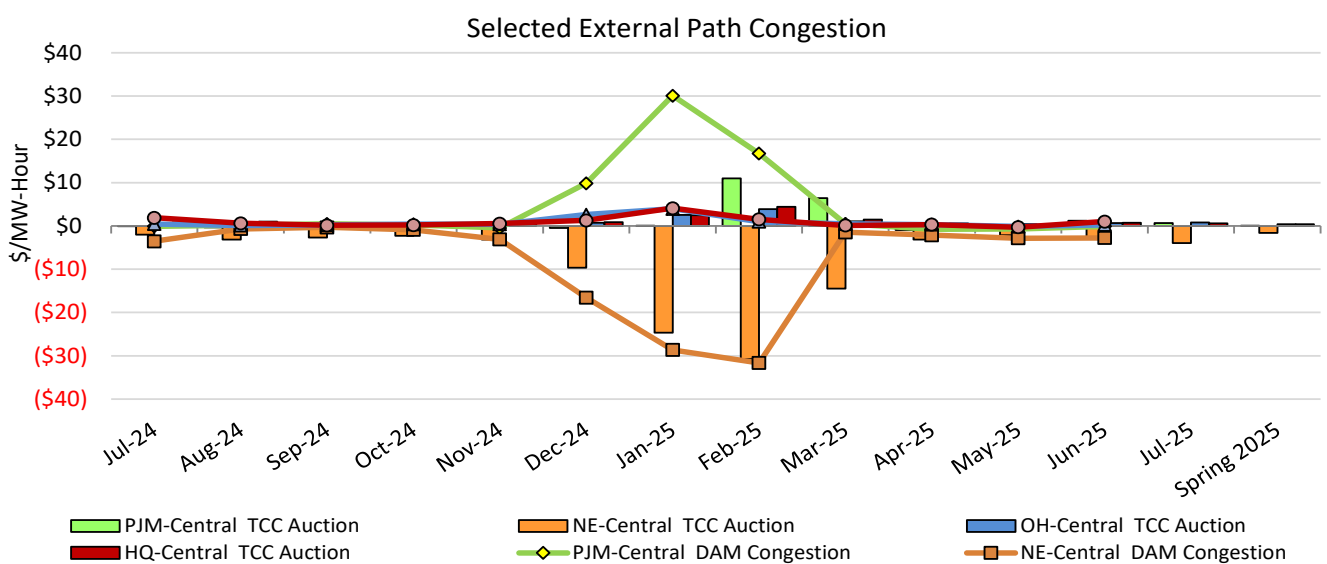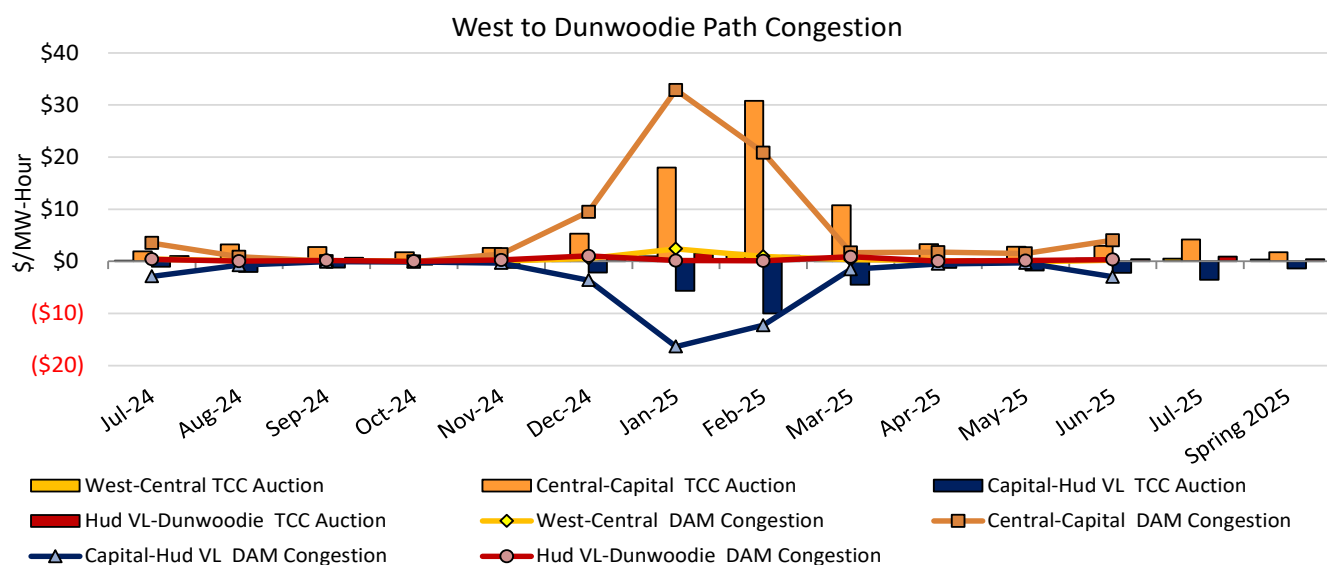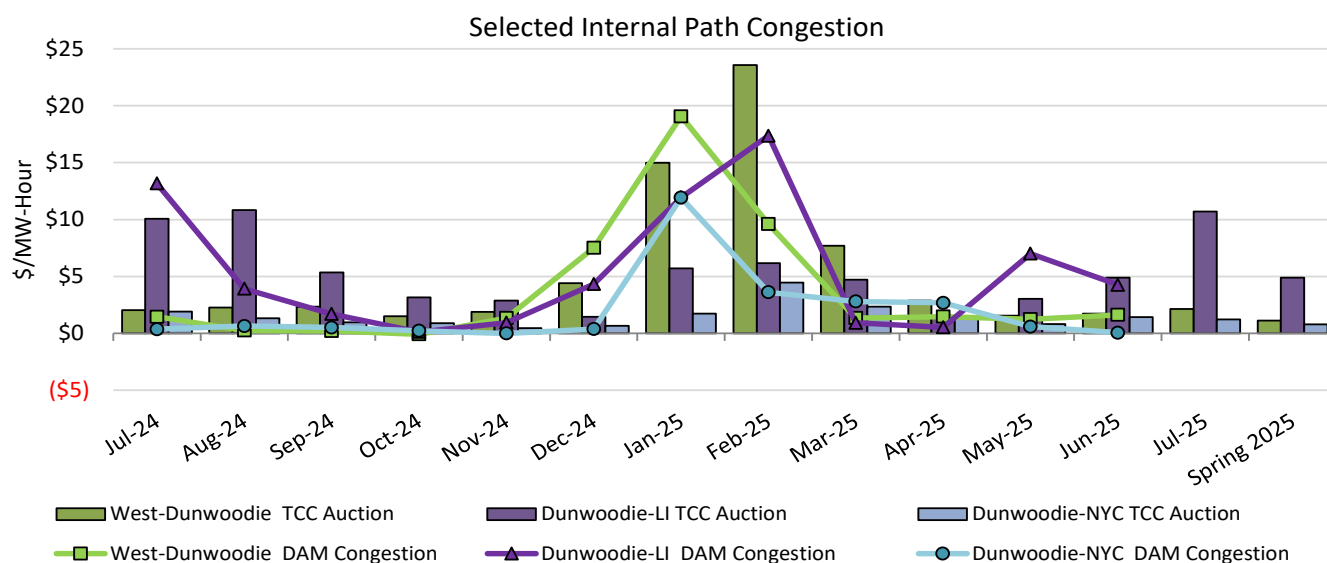

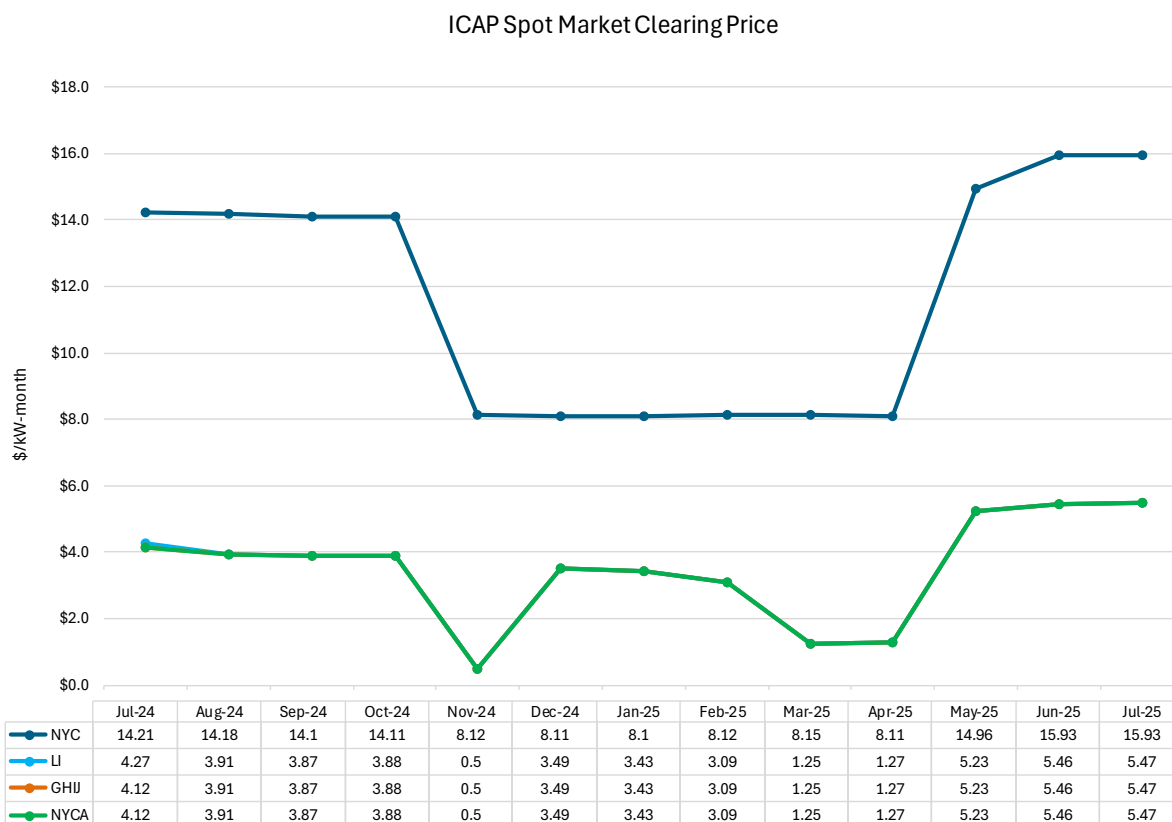

### Price Change Summary:

No significant price changes observed.

## Appendix A –Metric Definitions

- **Alert State:** The number of Alert State declarations reflect system operating conditions beyond thresholds associated with Normal and Warning States. Declaration of the Alert State allows the NYISO to take corrective actions not available in the Normal and Warning States.
- **Average Hourly Error %:** Average value of the ratio of hourly average error magnitude to hourly average actual load demand.
- **Capacity Factor:** The ratio of actual energy produced to the maximum energy that could have produced if operating at full capacity continuously during the same period.
- **Curtailed Energy:** Difference between real-time wind/FTM solar forecast and economic wind/FTM solar output limit.
- **Curtailed Energy %:** The ratio of curtailed energy to total energy production.
- **Day-Ahead Average Hourly Error %:** Average across all hours of the month of the absolute value of the difference between actual load demand and the Day-Ahead forecast load demand, divided by the actual load demand.
- **Day-Ahead Bias:** Avg (actual generation – Day-Ahead forecast generation) / capacity
- **Day-Ahead MAE Forecast Error:** Avg |actual generation – Day-Ahead forecast generation| / Capacity
- **Day-Ahead Market Capacity Unavailable:** Unavailable capacity is calculated as the difference of Day-Ahead Market capacity including SRE relative to the real-time (RT) capacity during RT peak load hour.
- **Disturbance Control Standard Event Time:** For NYISO initiated NERC Reportable Disturbances, the maximum ACE recovery time is identified. Recovery times less than 15 minutes are considered NERC compliant.
- **Hour-Ahead Bias:** Avg (actual generation – Hour-Ahead forecast generation) / capacity
- **Hour-Ahead MAE Forecast Error:** Avg |actual generation – Hour-Ahead forecast generation| / Capacity
- **Hour-Ahead MAE Persistence Error:** Avg |actual generation – Hour-Ahead actual generation| / Capacity
- **Hourly Error MW:** Value of the difference between the hourly average actual load demand and the average hour ahead forecast load demand.
- **Major Emergency:** The number of Major Emergency State declarations reflect system operating conditions beyond thresholds associated with the Alert State. Declaration of the Major Emergency State allows the NYISO to take additional corrective actions not available in the Alert State.
- **NERC Balancing Authority ACE Limit Standard:** The amount of time the clock-minute average ACE exceeds the clock-minute Balancing Authority ACE Limit (BAAL) is an indicator of the NYISO Area resource and demand balancing. The maximum BAAL exceedance time is identified. BAAL exceedances of less than 30 consecutive clock-minutes are NERC compliant.
- **NERC Control Performance Standard:** The value of NERC Control Performance Standard 1 (CPS-1) is an indicator of the NYISO Area resource and demand balancing. CPS-1 values greater than 100% are considered NERC compliant.
- **NERC IROL Time Over Limit:** For IROL exceedances leading to Major Emergency State declarations, the maximum IROL exceedance time is identified. IROL exceedances of less than thirty minutes are considered NERC compliant.
- **NERC Transmission Loading Relief (TLR):** Value represents the number of hours in which the NYISO requested TLR level 3 curtailments to provide transmission constraint relief.
- **Net Load:** Defined as Gross load less wind and solar generation.
- **Net Load Ramp:** Average value of the difference in load demand between the previous and current hour. Wind and solar ramps are negated to indicate their impact on Net load ramp.
- **Reserve Activation:** NYISO Reserve Activations are indicators of the need to respond to unexpected operational conditions within the NYISO Area or to assist a neighboring Area (Simultaneous Activation of Reserves) by activating an immediate resource and demand balancing operation.
- **Thunderstorm Alert (TSA):** TSA is declared by NYISO when severe operating conditions are detected. A predetermined set of pre-and post-contingency constraints are passed to the RTC and RTD programs while TSA is in effect. Value represents number of hours TSA was active.
- **13 Month Trailing Avg Carbon Emissions Free %:** Sum of internal NYCA generation from Nuclear, Hydro, Wind, Solar resources divided by Gross Load. Gross load is defined as metered load plus BTM solar estimated actuals.
- **13 Month Trailing Avg Renewables %:** Sum of internal NYCA generation from Hydro, Wind, Solar resources divided by Gross Load. Gross load is defined as metered load plus BTM solar estimated actuals.

## Appendix B –NYISO Information Resources

- [Annual Renewable Energy Performance Metrics](#)
- [Demand Response - NYISO](#)
- [Energy Market & Operational Data](#)
- [FERC Order 844 Zonal and Resource Specific Uplift Reports](#)
- [Installed Capacity Market Data](#)
- [Load & Capacity Data Report \(Gold Book\)](#)
- [Operating Committee - NYISO](#)
- [Systems Operations Advisory Subcommittee Report](#)
- [Transmission Congestion Contracts Market Data](#)